


**PUMP I**  
Relay in the Waterline Unit can be used as Pilot relays to a 110 VAC coil for contactors properly rated for pump operation.


To Waste or Reclaimed Tank

← Pump to waste or reclaimed water

## Lead-Lag Duplex Pump Down with High Alarm



Internal Relays (N.O.) are rated 30 amps at 250VAC.

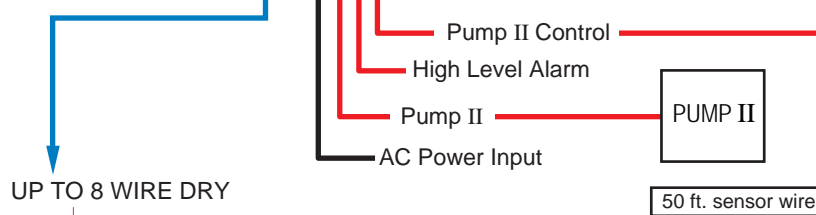


UP TO 8 WIRE DRY CONTACTS TO AUTOMATION SYSTEM - 2 for each function plus 2 for fault conditions. (see truth table for BAS wire quantities)

\* Contact the factory for Custom Sensor requirements.

\* See written specification for more details.

Reference - BLACK  
BLUE  
BROWN  
WHITE  
RED  
GREEN

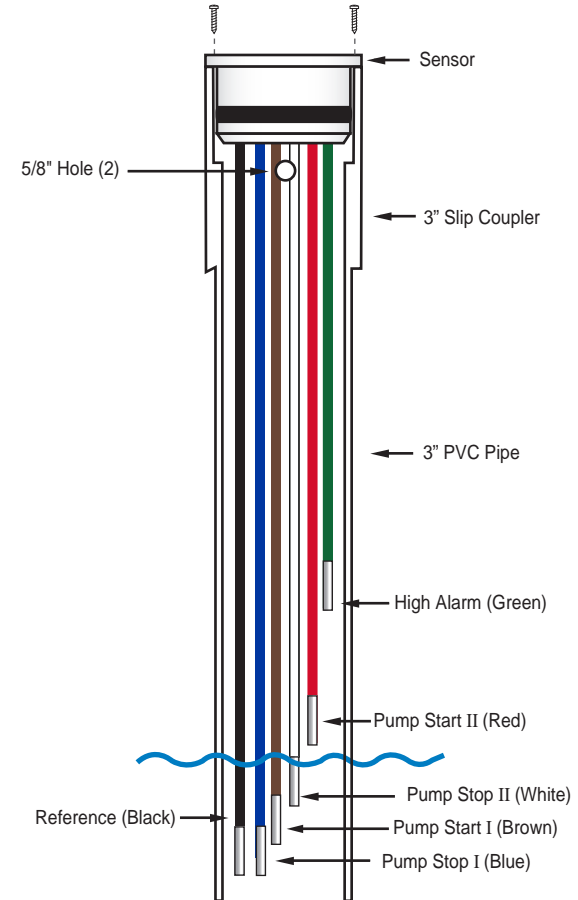

1. The 3" PVC Pipe needs to be at least 2" longer than the longest Sensor tip.
2. Adjustment occurs by moving the 3" PVC Pipe up or down and tightening the clamp so it rests on the Custom Fitting.