






# WLC-50-FPT FIRE PROTECTION TANK

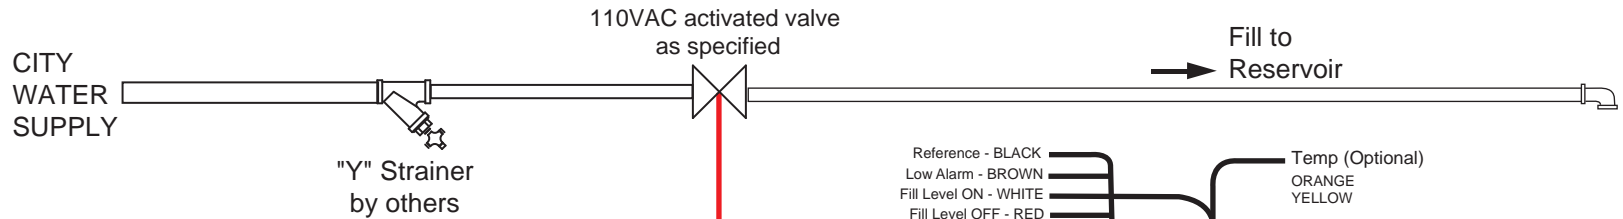

## Level Fill Control with Low and High Alarm




Internal Relays (N.O.) are rated 30 amps at 250VAC.

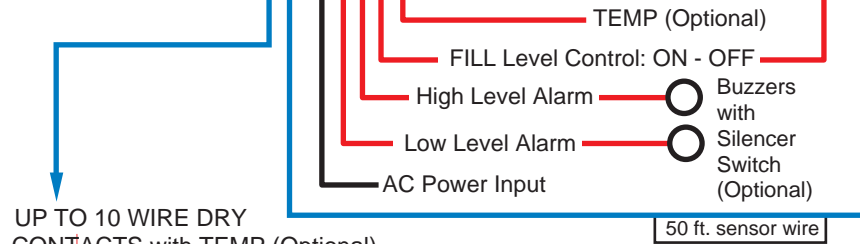

UP TO 10 WIRE DRY CONTACTS with TEMP (Optional) TO AUTOMATION SYSTEM - 2 for each function plus 2 for fault conditions. (see truth table for BMS wire quantities)

- \* Contact the factory for Custom Sensor requirements. Use Sensor Submittal sheet
- \* See written specification for more details.

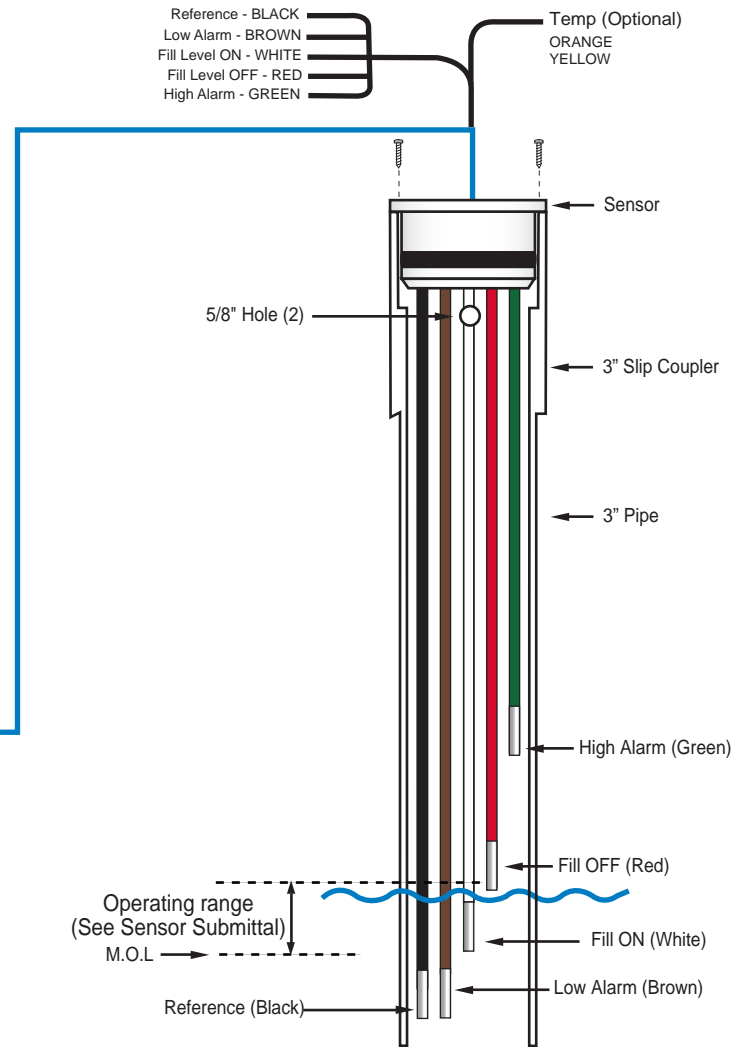

The 3" PVC Pipe needs to be at least 2" longer than the longest Sensor tip.